



AIR HANDLING UNIT eQ

Project 8575 () / eq  
AOC ACON-00557211  
Unit 9 () / EQ023  
Size 023

2.0.090924.3

2009-09-27

Page 1

**CONTROLS**

Product list

**Temperature sensor**

**STAZ-02-20-1-1-2**

**Electrical cabinet**

**STEQ-000-10-00-0-3-4-65-5-1-1**

Voltage: 3x400 VAC  
Control equipment: Siemens Climatix 600, TCP/IP + exp  
HMI (display): Alfanumerical, IP30  
Design: Standard  
Construction: eQ

**Temperature control**

**STAZ-01-2-1-1-1-0-0-0-1-65-1**

Type of control: Exhaust air control  
Night cooling: With free cooling  
Night heating: With  
Cooling recovery: With  
Controller: Siemens Climatix 600, TCP/IP + exp

**Temperature sensor**

**STAZ-02-10-1-2-5**

**Temperature sensor**

**STAZ-02-30-1-3-5**

**Temperature sensor**

**STAZ-02-70-1-3-5**

**Control documentation**

**STAZ-36-65-1-023-1-3-3-1**

**Communication**


**STAZ-51-65-1-1-3**

Controller: Saphir Climatix 600, TCP/IP + exp  
Web: Simple web  
Alarm via GSM: With GSM modem  
Communication protocol: BACnet IP

**Switch disconnecter**

**STAZ-80-029-1-5**

Max current: 029  
Auxiliary switch: With auxiliary contacts (1NO, 1NC)  
Delivery options: Supplied with STEQ

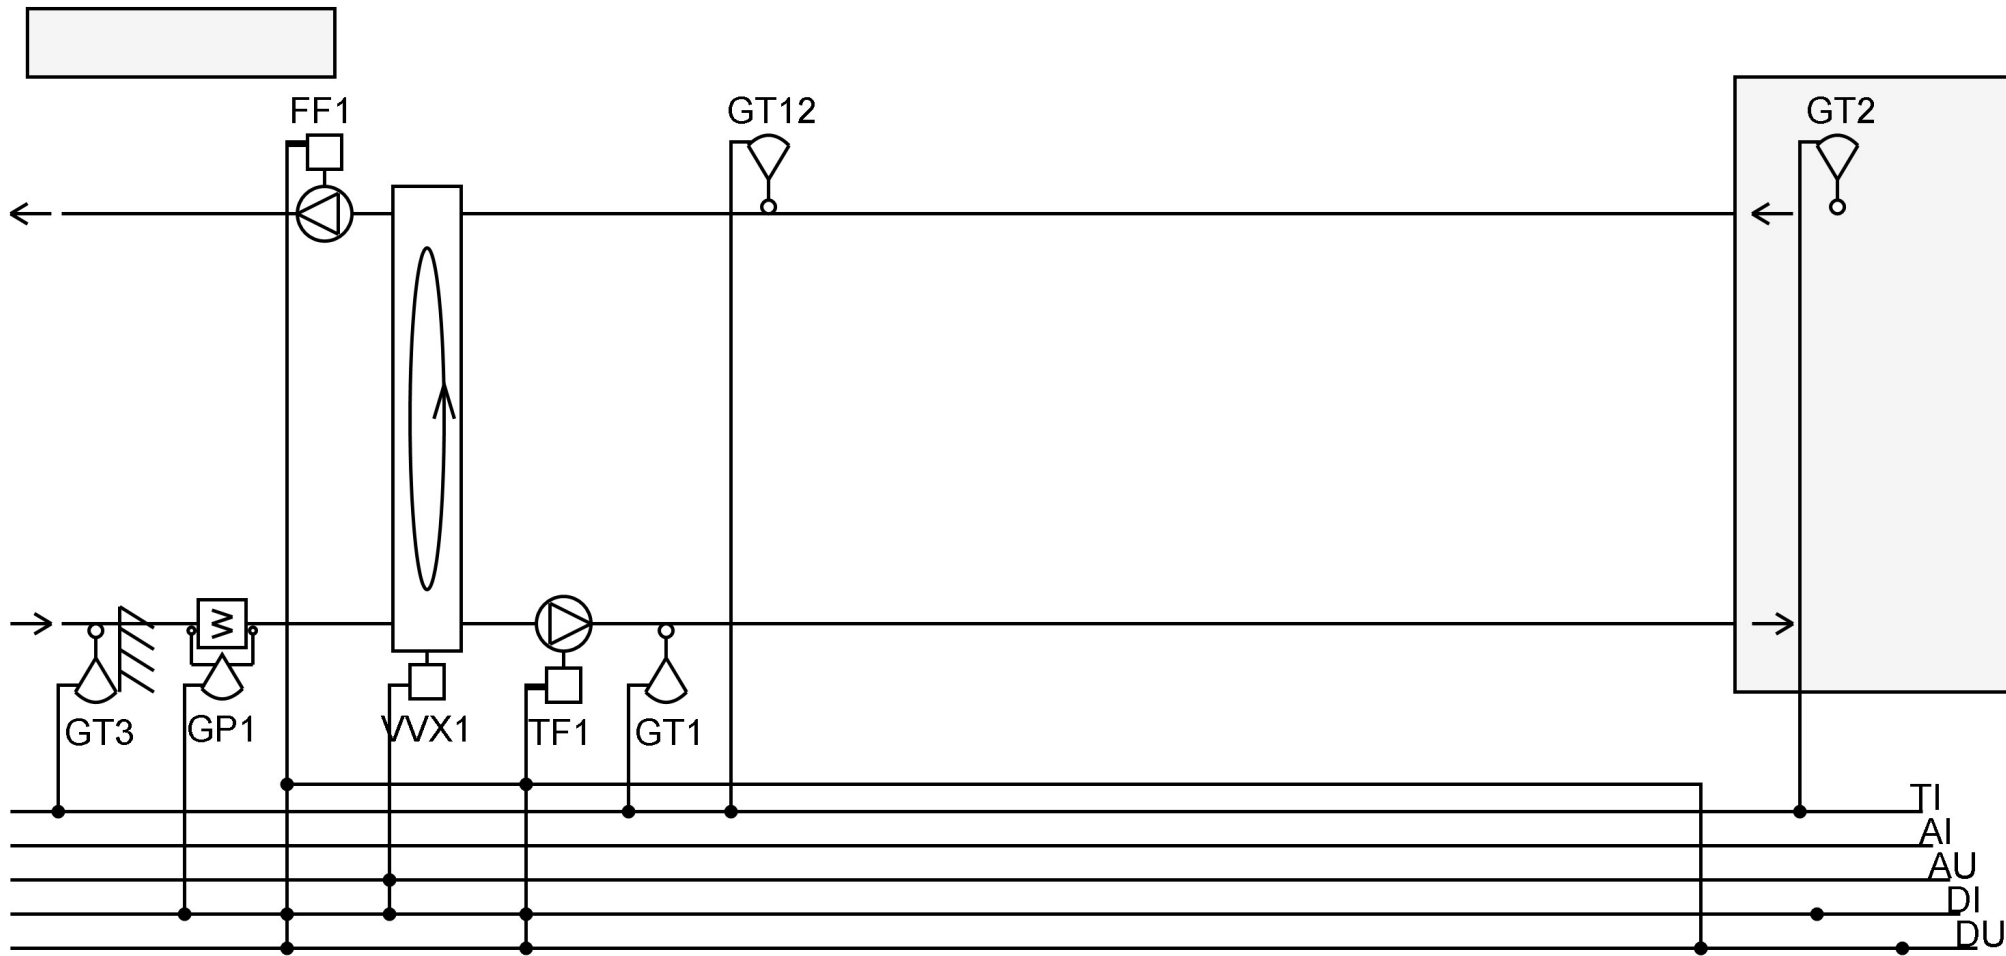

2009-09-27

Customer id	2459	Project name	
Project	8575	Unit name	
Uid	9		
AOC	ACON-00557211		

eq  
( ) / EQ023



Reference

Description

Type

**Customer id** 2459  
**Project** 8575  
**Uid** 9  
**AOC** ACON-00557211

**Project name**  
**Unit name**

eq  
( ) / EQ023

